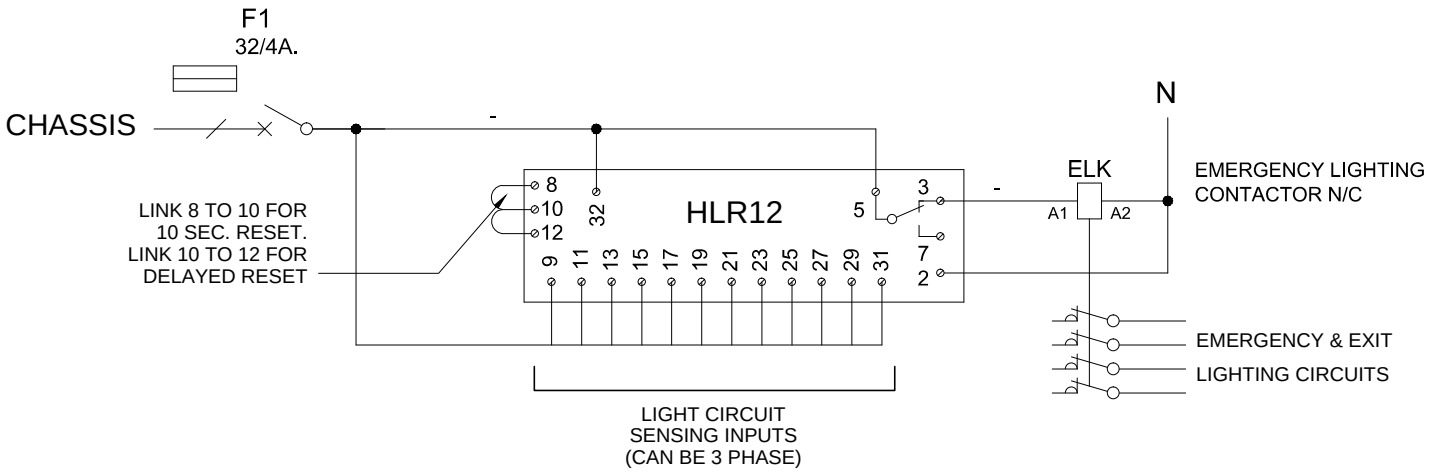

UNLESS OTHERWISE SPECIFIED ALL SENSING CIRCUITS SHALL BE CONNECTED TO THE CONTROL/SUPPLY CIRCUIT BREAKER. THE CUSTOMER SHALL CONNECT APPLICABLE SENSING CIRCUITS ACCORDING TO SITE REQUIREMENTS.

WARNING

INTERRUPTING SUPPLY WILL

DISCHARGE EMERGENCY LIGHTING BATTERIES

THIS DRAWING & THE INFORMATION CONTAINED THEREIN IS THE COPYRIGHT PROPERTY OF CBI-ELECTRIC PTY. LTD. AND SHALL NOT BE USED, REPRODUCED OR SHOWN TO THIRD PARTIES WITHOUT THE WRITTEN CONSENT OF CBI-ELECTRIC PTY. LTD.

No.	REVISION	BY	DATE

ACAD REF. No. A3 DO NOT SCALE

DRAWN | DATE | SCALE NTS

CHECKED | DATE | ALL DIMENSIONS IN MILLIMETRES

0 100 200 300 400

CLIENT

CBI electric Australia

A.C.N. 007 308 670
MELBOURNE, SYDNEY, NEWCASTLE, BRISBANE, TOWNSVILLE, ADELAIDE & PERTH
Heinemann Electric Pty Ltd Trading as CBI-electric: Australia

PROJECT

BOARD DESIGNATION

CUSTOMER REF. | SO No.

DRAWING No. **HLR12 SCHEMATIC**

SHEET 1 OF 1 | REV. 1