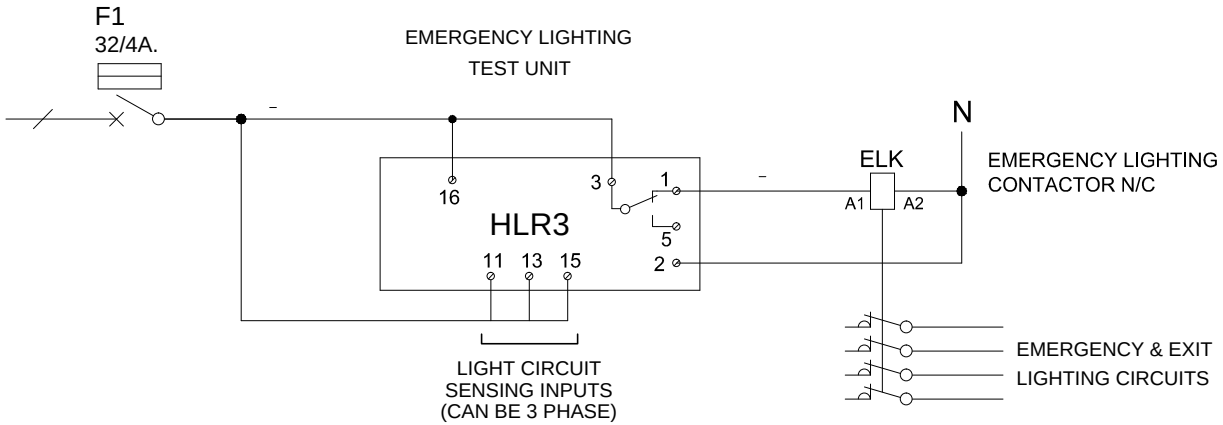

UNLESS OTHERWISE SPECIFIED ALL SENSING CIRCUITS
SHALL BE CONNECTED TO THE CONTROL/SUPPLY CIRCUIT BREAKER.
THE CUSTOMER SHALL CONNECT APPLICABLE SENSING CIRCUITS
ACCORDING TO SITE REQUIREMENTS.

WARNING

INTERRUPTING SUPPLY WILL

DISCHARGE EMERGENCY LIGHTING BATTERIES

THIS DRAWING & THE INFORMATION CONTAINED THEREIN IS THE COPYRIGHT PROPERTY OF CBI-ELECTRIC PTY. LTD. AND SHALL NOT BE USED, REPRODUCED OR SHOWN TO THIRD PARTIES WITHOUT THE WRITTEN CONSENT OF CBI-ELECTRIC PTY. LTD.

No.	REVISION	BY	DATE

ACAD REF. No.	A3 DO NOT SCALE	
DRAWN	DATE	SCALE NTS
CHECKED	DATE	ALL DIMENSIONS IN MILLIMETRES

0 100 200 300 400

CLIENT

CBI electric Australia
A.C.N. 007 308 670
MELBOURNE, SYDNEY, NEWCASTLE, BRISBANE, TOWNSVILLE, ADELAIDE & PERTH
Heinemann Electric Pty Ltd Trading as CBI-electric: Australia

PROJECT		
BOARD DESIGNATION		
CUSTOMER REF.	SO No.	
DRAWING No. HLR3 SCHEMATIC	SHEET 1 OF 1	REV. 1